

# AWTA PRODUCT TESTING

Australian Wool Testing Authority Ltd - trading as AWTA Product Testing  
A.B.N 43 006 014 106  
1st Floor, 191 Racecourse Road, Flemington, Victoria 3031  
P.O Box 240, North Melbourne, Victoria 3051  
Phone (03) 9371 2400 Fax (03) 9371 2499

## TEST REPORT

**Client :** Tarkett AB  
Ronnebyhamn,  
372 81 Ronneby Sweden  
Sweden

**Test Number :** 17-001251  
**Issue Date :** 30/03/2017  
**Print Date :** 8/05/2017

**Sample Description** Clients Ref : "Wallgard"  
Wall covering sheet  
Colour : White  
End Use : Wall Cover  
Nominal Composition : PVC, Filler, Plasticizer  
Nominal Mass per Unit Area/Density : 1700kg/m<sup>3</sup>  
Nominal Thickness : 2.0mm

### ISO 5660.1-2015

Reaction to Fire Tests - Heat Release Smoke Production and Mass Loss Rate Part 1: Heat Release Rate (Cone Calorimeter Method) and Smoke Production Rate (Dynamic Measurement)

	Specimen			Mean	
	1	2	3		
Average Heat Release Rate	18.2	16.1	15.6	16.6	kW/m <sup>2</sup>
Group Number Classification	1S	1S	1S		

(In Accordance with New Zealand Building Code Verification Method C/VM2 Appendix A)

	1	2	3	Mean	
Average Specific extinction area	22.0	51.7	38.0	37.2	m <sup>2</sup> /kg

Test orientation : Horizontal

	Specimen			Mean	
	1	2	3		
Irradiance	50	50	50	50	kW/m <sup>2</sup>
Exhaust flow rate	24	24	24	24	L/sec
Time to sustained flaming	38	40	37	38	sec
Test duration	1838	1840	1837	1838	sec

52642

18214

Page 1 of 8

© Australian Wool testing Authority Ltd  
Copyright - All Rights Reserved



Accredited for compliance with ISO/IEC 17025  
- Chemical Testing  
- Mechanical Testing  
- Performance & Approvals Testing

: Accreditation No. 983  
: Accreditation No. 985  
: Accreditation No. 1356



Samples and their identifying descriptions have been provided by the client unless otherwise stated. AWTA Ltd makes no warranty, implied or otherwise, as to the source of the tested samples. The above test results relate only to the sample or samples tested. This document shall not be reproduced except in full and shall be rendered void if amended or altered. This document, the names AWTA Product Testing and AWTA Ltd may be used in advertising providing the content and format of the advertisement have been approved by the Managing Director of AWTA Ltd.

APPROVED SIGNATORY

MICHAEL A. JACKSON B.Sc.(Hons)  
MANAGING DIRECTOR

# AWTA PRODUCT TESTING

Australian Wool Testing Authority Ltd - trading as AWTA Product Testing

A.B.N 43 006 014 106

1st Floor, 191 Racecourse Road, Flemington, Victoria 3031

P.O Box 240, North Melbourne, Victoria 3051

Phone (03) 9371 2400 Fax (03) 9371 2499

## TEST REPORT

**Client :** Tarkett AB  
Ronnebyhamn,  
372 81 Ronneby Sweden  
Sweden

**Test Number :** 17-001251  
**Issue Date :** 30/03/2017  
**Print Date :** 8/05/2017

Peak heat release after ignition	59.6	66.1	59.4	61.7	kW/m <sup>2</sup>
Average heat at 60 s	49.6	53.0	48.5	50.4	kW/m <sup>2</sup>
Average heat at 180 s	48.3	48.1	46.1	47.5	kW/m <sup>2</sup>
Average heat at 300 s	39.2	36.0	37.0	37.4	kW/m <sup>2</sup>
Total heat released	32.8	28.9	28.1	29.9	MJ/m <sup>2</sup>
Average effective heat of combustion	7.9	7.0	7.0	7.3	MJ/kg
Initial thickness	8.0	8.0	8.0	8.0	mm
Initial mass	119.8	119.3	119.4	119.5	g
Mass remaining	85.5	85.5	86.0	85.6	g
Mass percentage pyrolysed	28.7	28.3	28.0	28.3	%
Mass loss	34.3	33.8	33.4	33.9	g
Average rate of mass loss	2.3	2.3	2.2	2.3	g/m <sup>2</sup> .s

These test results relate only to the behaviour of the product under the conditions of the test, they are not intended to be the sole criterion for assessment of performance under real fire conditions.

Tests were conducted with a wire grid placed over the sample during testing. This was done to contain intumescent sample within the sample holder.

Samples were loose laid onto a substrate of 6mm thick cement sheeting prior to testing.

Note: All calculations are based on ignition + 30 minutes.

52642

18214

Page 2 of 8

© Australian Wool testing Authority Ltd  
Copyright - All Rights Reserved



Accredited for compliance with ISO/IEC 17025  
- Chemical Testing  
- Mechanical Testing  
- Performance & Approvals Testing

: Accreditation No. 983  
: Accreditation No. 985  
: Accreditation No. 1356



Samples and their identifying descriptions have been provided by the client unless otherwise stated. AWTA Ltd makes no warranty, implied or otherwise, as to the source of the tested samples. The above test results relate only to the sample or samples tested. This document shall not be reproduced except in full and shall be rendered void if amended or altered. This document, the names AWTA Product Testing and AWTA Ltd may be used in advertising providing the content and format of the advertisement have been approved by the Managing Director of AWTA Ltd.

APPROVED SIGNATORY

MICHAEL A. JACKSON B.Sc.(Hons)  
MANAGING DIRECTOR

# AWTA PRODUCT TESTING

Australian Wool Testing Authority Ltd - trading as AWTA Product Testing

A.B.N 43 006 014 106

1st Floor, 191 Racecourse Road, Flemington, Victoria 3031

P.O Box 240, North Melbourne, Victoria 3051

Phone (03) 9371 2400 Fax (03) 9371 2499


## TEST REPORT

**Client :** Tarkett AB  
Ronnebyhamn,  
372 81 Ronneby Sweden  
Sweden


**Test Number :** 17-001251  
**Issue Date :** 30/03/2017  
**Print Date :** 8/05/2017

**Specimen :** 1


Heat release rate (kW/m<sup>2</sup>)

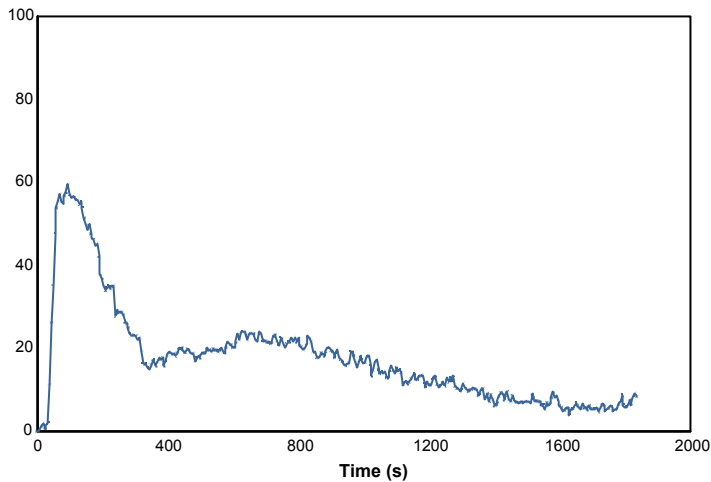


Effective heat of combustion (MJ/kg)

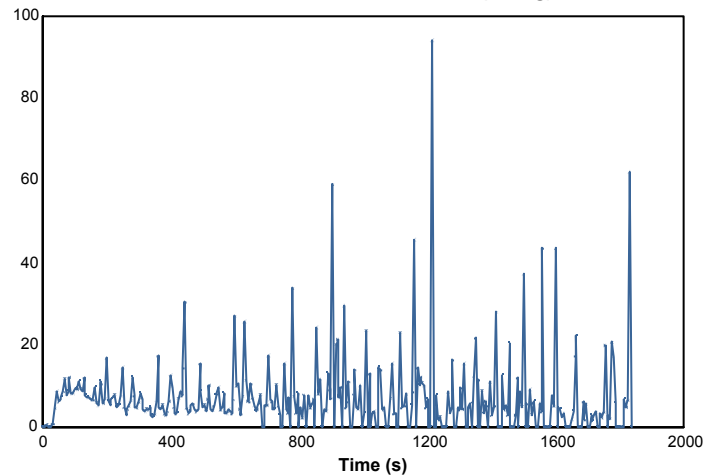

Smoke production rate ([m<sup>2</sup>/s])

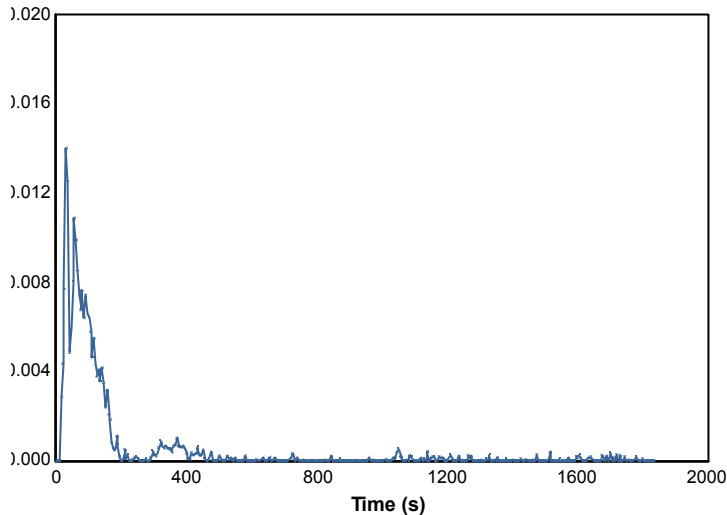

Specific extinction area (m<sup>2</sup>/kg)

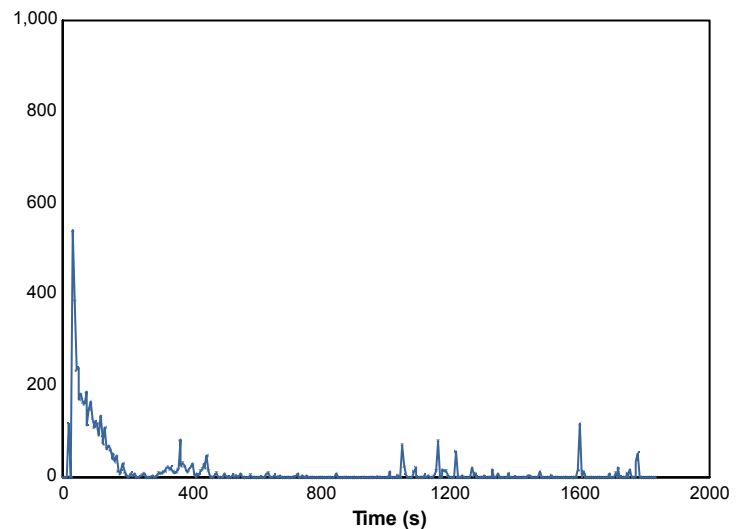

52642

18214

Page 3 of 8

© Australian Wool testing Authority Ltd  
Copyright - All Rights Reserved



Accredited for compliance with ISO/IEC 17025

- Chemical Testing  
- Mechanical Testing  
- Performance & Approvals Testing

: Accreditation No. 983  
: Accreditation No. 985  
: Accreditation No. 1356



Samples and their identifying descriptions have been provided by the client unless otherwise stated. AWTA Ltd makes no warranty, implied or otherwise, as to the source of the tested samples. The above test results relate only to the sample or samples tested. This document shall not be reproduced except in full and shall be rendered void if amended or altered. This document, the names AWTA Product Testing and AWTA Ltd may be used in advertising providing the content and format of the advertisement have been approved by the Managing Director of AWTA Ltd.

APPROVED SIGNATORY

MICHAEL A. JACKSON B.Sc.(Hons)  
MANAGING DIRECTOR

# AWTA PRODUCT TESTING

Australian Wool Testing Authority Ltd - trading as AWTA Product Testing

A.B.N 43 006 014 106

1st Floor, 191 Racecourse Road, Flemington, Victoria 3031

P.O Box 240, North Melbourne, Victoria 3051


Phone (03) 9371 2400 Fax (03) 9371 2499

## TEST REPORT


**Client :** Tarkett AB  
Ronnebyhamn,  
372 81 Ronneby Sweden  
Sweden

**Test Number :** 17-001251  
**Issue Date :** 30/03/2017  
**Print Date :** 8/05/2017


Mass loss rate (g/s)

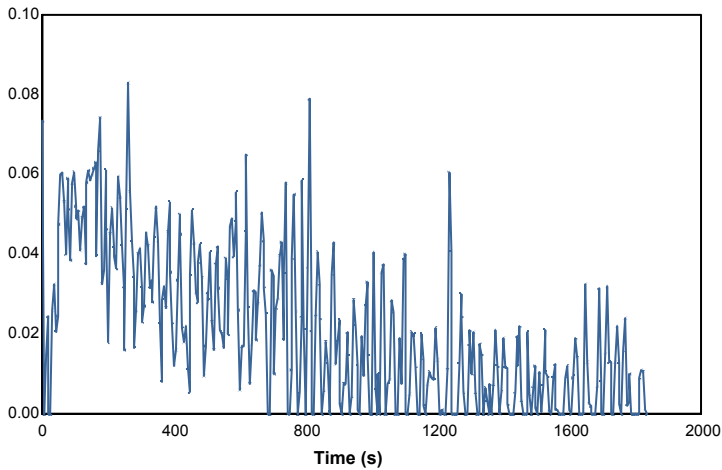


Total heat released (MJ/m²)

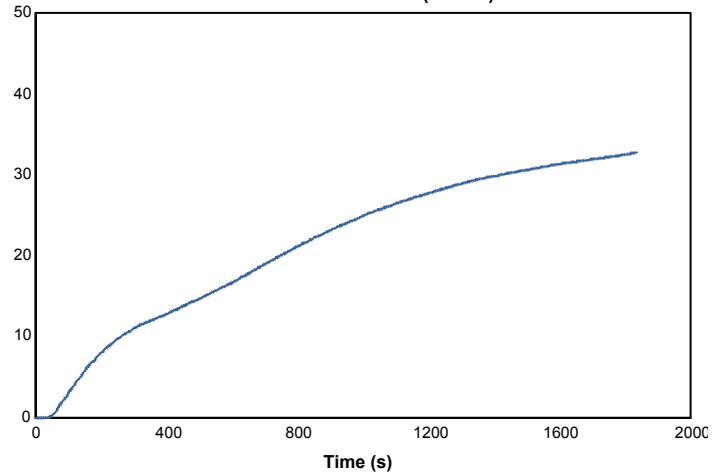

Mass (g)

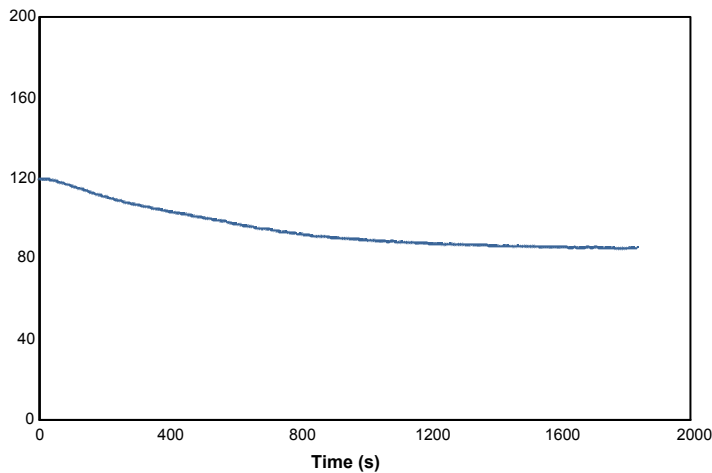

Rate of smoke release ([m²/s]/m²)

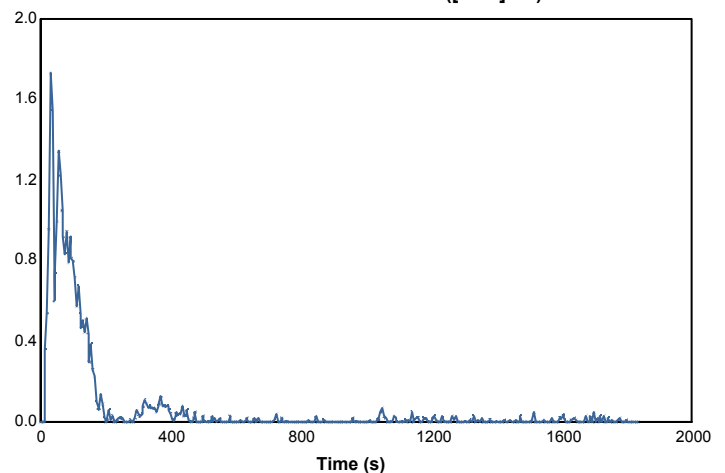

52642

18214

Page 4 of 8

© Australian Wool testing Authority Ltd  
Copyright - All Rights Reserved



Accredited for compliance with ISO/IEC 17025

- Chemical Testing  
- Mechanical Testing  
- Performance & Approvals Testing

: Accreditation No. 983  
: Accreditation No. 985  
: Accreditation No. 1356



Samples and their identifying descriptions have been provided by the client unless otherwise stated. AWTA Ltd makes no warranty, implied or otherwise, as to the source of the tested samples. The above test results relate only to the sample or samples tested. This document shall not be reproduced except in full and shall be rendered void if amended or altered. This document, the names AWTA Product Testing and AWTA Ltd may be used in advertising providing the content and format of the advertisement have been approved by the Managing Director of AWTA Ltd.

APPROVED SIGNATORY

MICHAEL A. JACKSON B.Sc.(Hons)  
MANAGING DIRECTOR

# AWTA PRODUCT TESTING

Australian Wool Testing Authority Ltd - trading as AWTA Product Testing

A.B.N 43 006 014 106

1st Floor, 191 Racecourse Road, Flemington, Victoria 3031

P.O Box 240, North Melbourne, Victoria 3051

Phone (03) 9371 2400 Fax (03) 9371 2499


## TEST REPORT

**Client :** Tarkett AB  
Ronnebyhamn,  
372 81 Ronneby Sweden  
Sweden


**Test Number :** 17-001251  
**Issue Date :** 30/03/2017  
**Print Date :** 8/05/2017

**Specimen :** 2


Heat release rate (kW/m<sup>2</sup>)

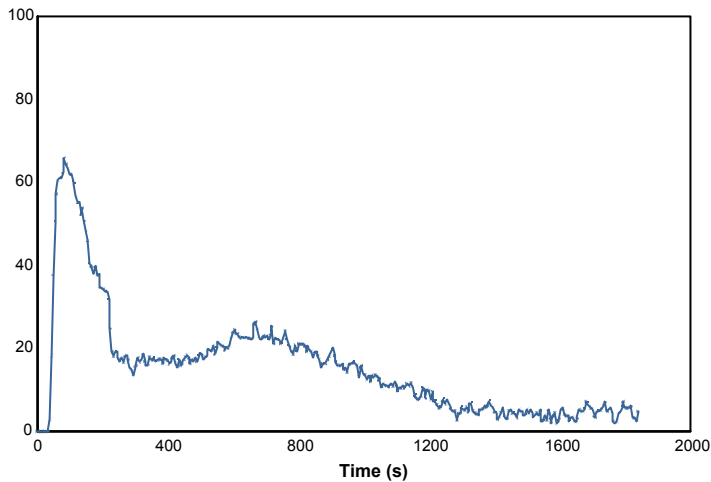


Effective heat of combustion (MJ/kg)

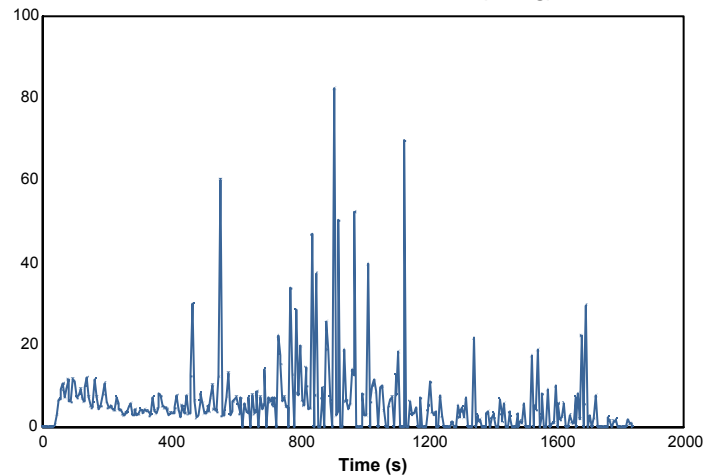

Smoke production rate ([m<sup>2</sup>/s])

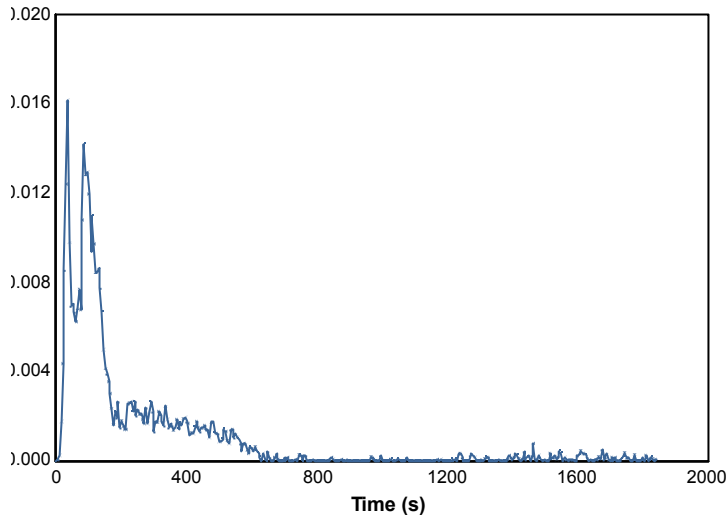

Specific extinction area (m<sup>2</sup>/kg)

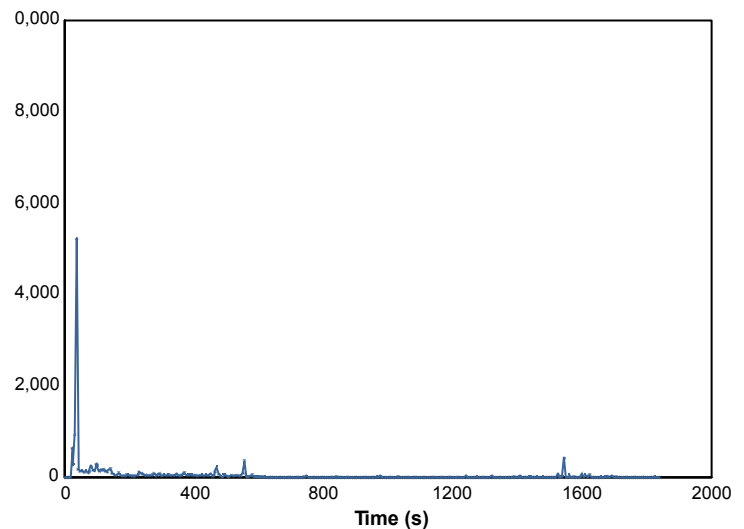

52642

18214

Page 5 of 8

© Australian Wool testing Authority Ltd  
Copyright - All Rights Reserved



Accredited for compliance with ISO/IEC 17025  
- Chemical Testing  
- Mechanical Testing  
- Performance & Approvals Testing

: Accreditation No. 983  
: Accreditation No. 985  
: Accreditation No. 1356



Samples and their identifying descriptions have been provided by the client unless otherwise stated. AWTA Ltd makes no warranty, implied or otherwise, as to the source of the tested samples. The above test results relate only to the sample or samples tested. This document shall not be reproduced except in full and shall be rendered void if amended or altered. This document, the names AWTA Product Testing and AWTA Ltd may be used in advertising providing the content and format of the advertisement have been approved by the Managing Director of AWTA Ltd.

APPROVED SIGNATORY

MICHAEL A. JACKSON B.Sc.(Hons)  
MANAGING DIRECTOR

# AWTA PRODUCT TESTING

Australian Wool Testing Authority Ltd - trading as AWTA Product Testing

A.B.N 43 006 014 106

1st Floor, 191 Racecourse Road, Flemington, Victoria 3031

P.O Box 240, North Melbourne, Victoria 3051


Phone (03) 9371 2400 Fax (03) 9371 2499

## TEST REPORT


**Client :** Tarkett AB  
Ronnebyhamn,  
372 81 Ronneby Sweden  
Sweden

**Test Number :** 17-001251  
**Issue Date :** 30/03/2017  
**Print Date :** 8/05/2017


Mass loss rate (g/s)

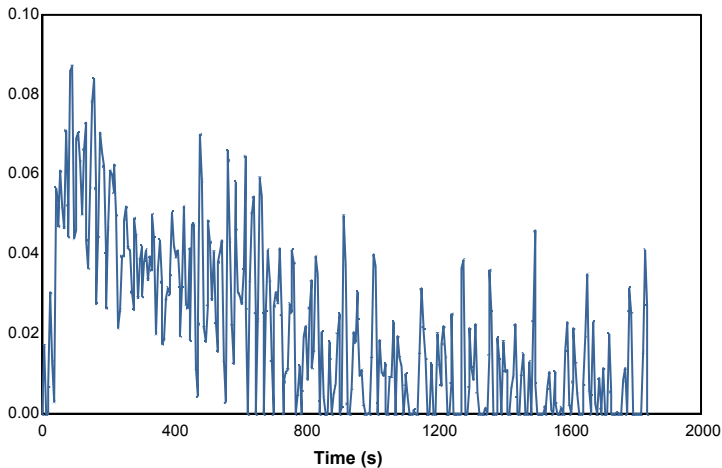


Total heat released (MJ/m²)

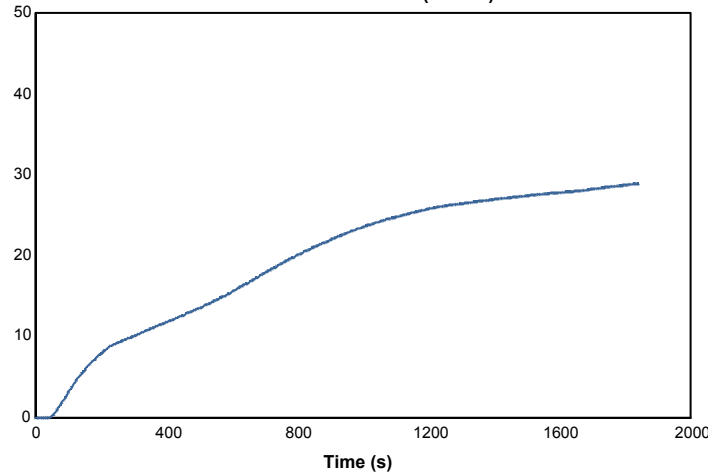

Mass (g)

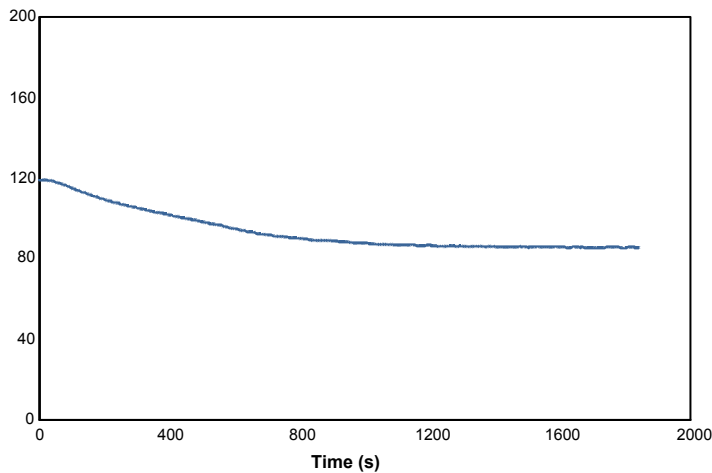

Rate of smoke release ([m²/s]/m²)

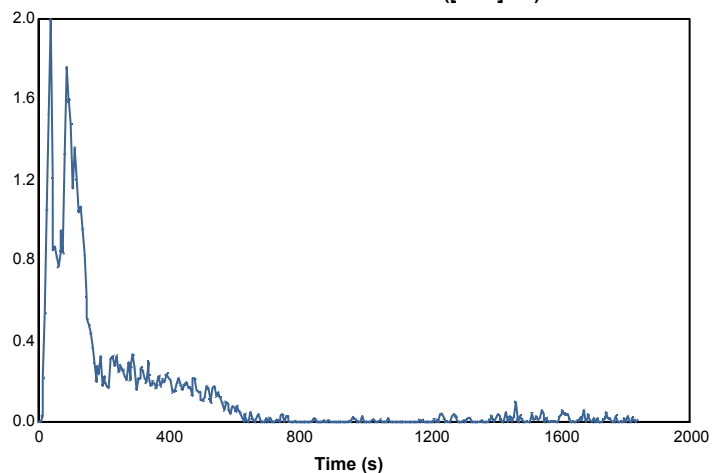

52642

18214

Page 6 of 8

© Australian Wool testing Authority Ltd  
Copyright - All Rights Reserved



Accredited for compliance with ISO/IEC 17025

- Chemical Testing
- Mechanical Testing
- Performance & Approvals Testing

: Accreditation No. 983  
: Accreditation No. 985  
: Accreditation No. 1356



Samples and their identifying descriptions have been provided by the client unless otherwise stated. AWTA Ltd makes no warranty, implied or otherwise, as to the source of the tested samples. The above test results relate only to the sample or samples tested. This document shall not be reproduced except in full and shall be rendered void if amended or altered. This document, the names AWTA Product Testing and AWTA Ltd may be used in advertising providing the content and format of the advertisement have been approved by the Managing Director of AWTA Ltd.

APPROVED SIGNATORY

MICHAEL A. JACKSON B.Sc.(Hons)  
MANAGING DIRECTOR

# AWTA PRODUCT TESTING

Australian Wool Testing Authority Ltd - trading as AWTA Product Testing

A.B.N 43 006 014 106

1st Floor, 191 Racecourse Road, Flemington, Victoria 3031

P.O Box 240, North Melbourne, Victoria 3051

Phone (03) 9371 2400 Fax (03) 9371 2499


## TEST REPORT

**Client :** Tarkett AB  
Ronnebyhamn,  
372 81 Ronneby Sweden  
Sweden


**Test Number :** 17-001251  
**Issue Date :** 30/03/2017  
**Print Date :** 8/05/2017

**Specimen :** 3


Heat release rate (kW/m<sup>2</sup>)

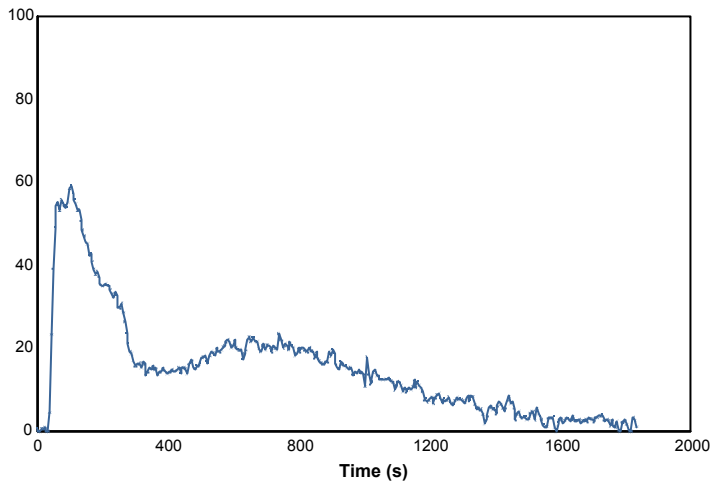


Effective heat of combustion (MJ/kg)

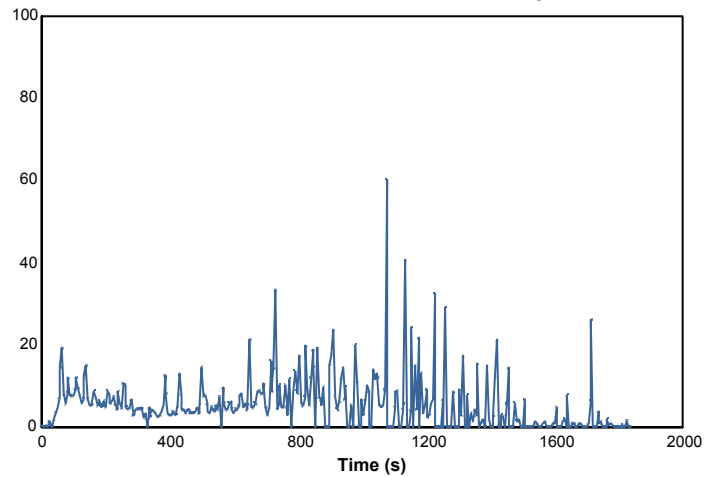

Smoke production rate ([m<sup>2</sup>/s])

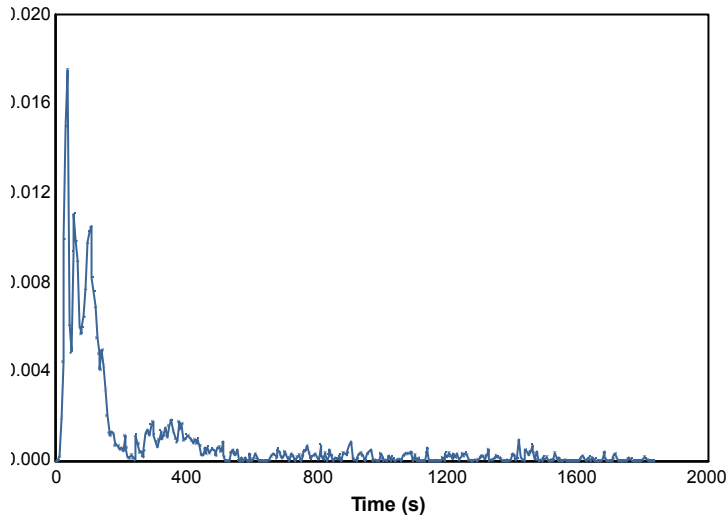

Specific extinction area (m<sup>2</sup>/kg)

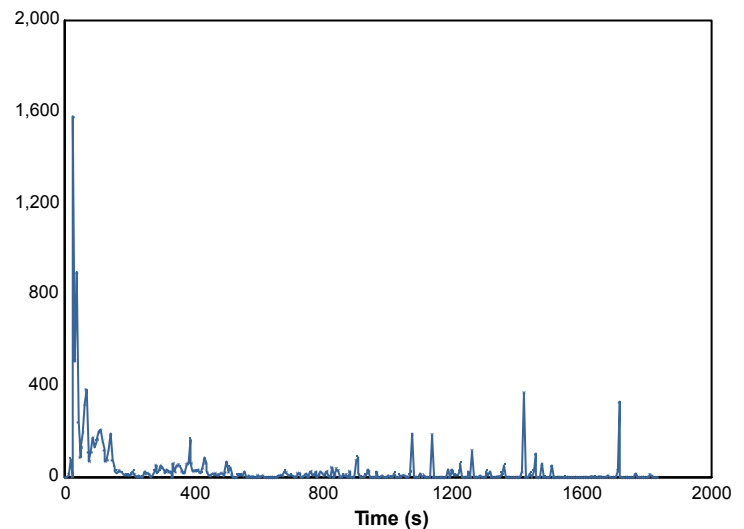

52642

18214

Page 7 of 8

© Australian Wool testing Authority Ltd  
Copyright - All Rights Reserved



Accredited for compliance with ISO/IEC 17025  
- Chemical Testing  
- Mechanical Testing  
- Performance & Approvals Testing

: Accreditation No. 983  
: Accreditation No. 985  
: Accreditation No. 1356



Samples and their identifying descriptions have been provided by the client unless otherwise stated. AWTA Ltd makes no warranty, implied or otherwise, as to the source of the tested samples. The above test results relate only to the sample or samples tested. This document shall not be reproduced except in full and shall be rendered void if amended or altered. This document, the names AWTA Product Testing and AWTA Ltd may be used in advertising providing the content and format of the advertisement have been approved by the Managing Director of AWTA Ltd.

APPROVED SIGNATORY

MICHAEL A. JACKSON B.Sc.(Hons)  
MANAGING DIRECTOR

# AWTA PRODUCT TESTING

Australian Wool Testing Authority Ltd - trading as AWTA Product Testing

A.B.N 43 006 014 106

1st Floor, 191 Racecourse Road, Flemington, Victoria 3031

P.O Box 240, North Melbourne, Victoria 3051


Phone (03) 9371 2400 Fax (03) 9371 2499

## TEST REPORT


**Client :** Tarkett AB  
Ronnebyhamn,  
372 81 Ronneby Sweden  
Sweden

**Test Number :** 17-001251  
**Issue Date :** 30/03/2017  
**Print Date :** 8/05/2017


Mass loss rate (g/s)

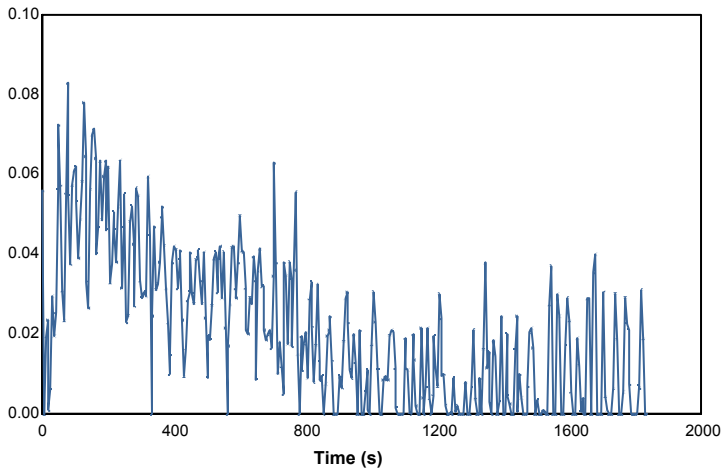


Total heat released (MJ/m<sup>2</sup>)

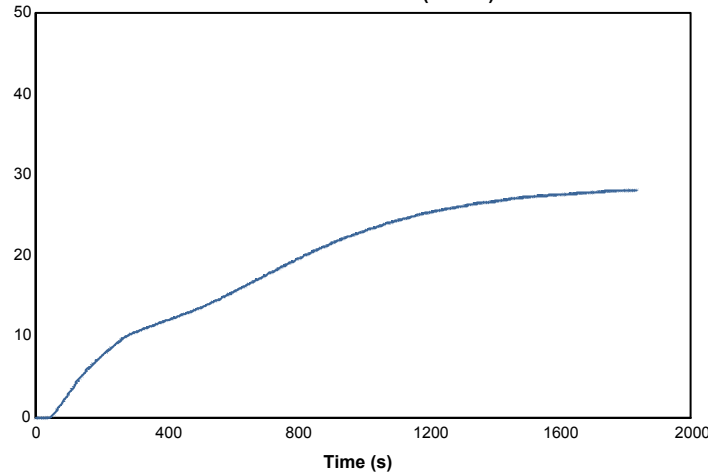

Mass (g)

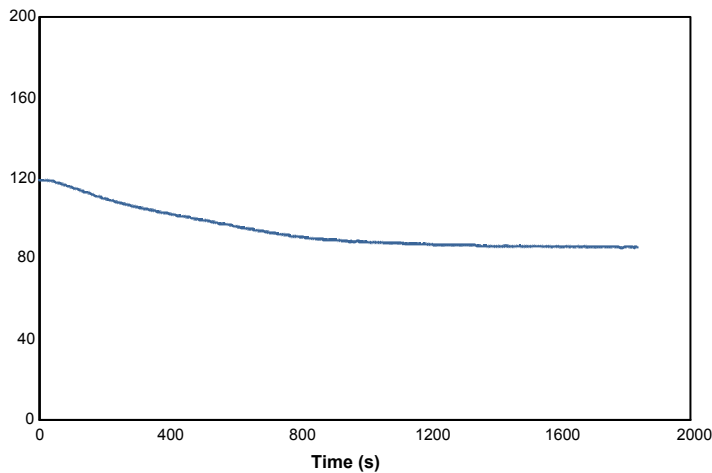

Rate of smoke release ([m<sup>2</sup>/s)/m<sup>2</sup>)

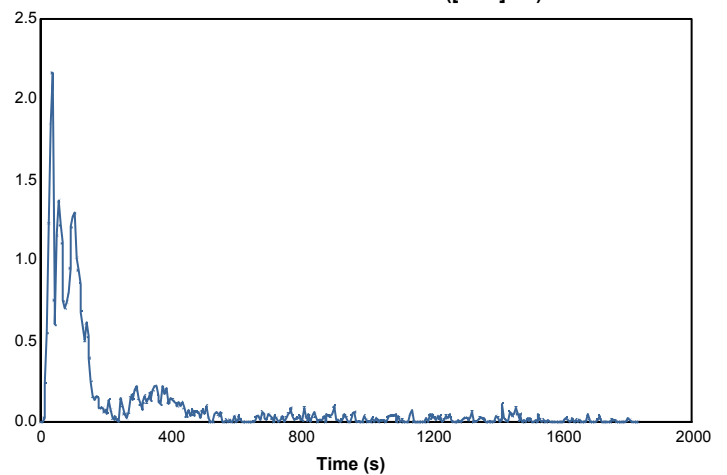

52642

18214

Page 8 of 8

© Australian Wool testing Authority Ltd  
Copyright - All Rights Reserved



Accredited for compliance with ISO/IEC 17025

- Chemical Testing  
- Mechanical Testing  
- Performance & Approvals Testing

: Accreditation No. 983  
: Accreditation No. 985  
: Accreditation No. 1356



Samples and their identifying descriptions have been provided by the client unless otherwise stated. AWTA Ltd makes no warranty, implied or otherwise, as to the source of the tested samples. The above test results relate only to the sample or samples tested. This document shall not be reproduced except in full and shall be rendered void if amended or altered. This document, the names AWTA Product Testing and AWTA Ltd may be used in advertising providing the content and format of the advertisement have been approved by the Managing Director of AWTA Ltd.

APPROVED SIGNATORY

MICHAEL A. JACKSON B.Sc.(Hons)  
MANAGING DIRECTOR